




[ISSUE 56] APRIL 09

TECHNICAL NEWS

INDUSTRIAL SWITCHGEAR & AUTOMATION SPECIALISTS

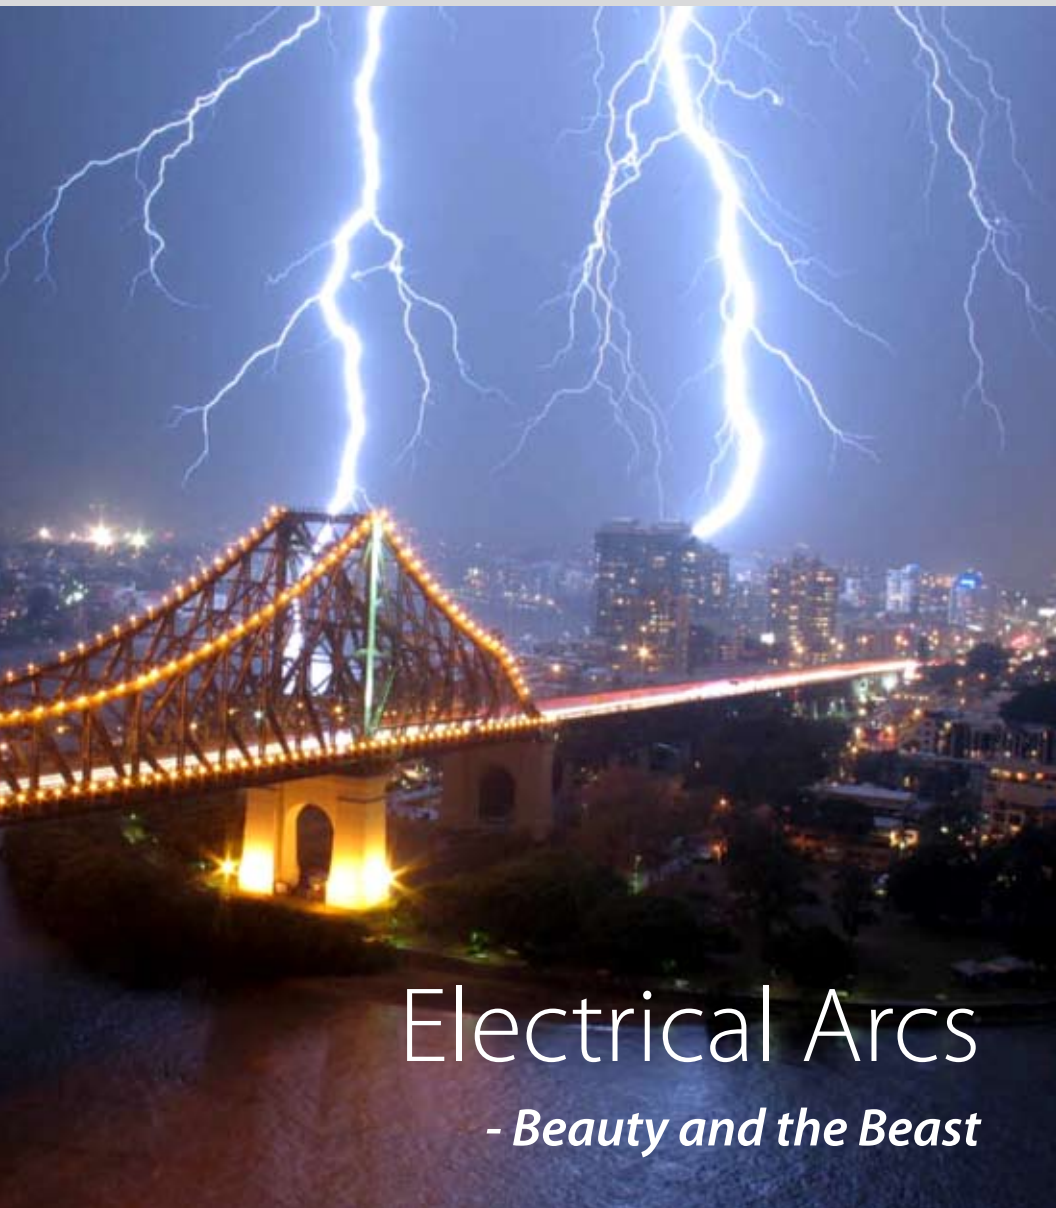

Electrical Arcs

- Beauty and the Beast


FEATURING

An electrical arc occurs when there is an electrical breakdown of a normally non-conductive media, such as air, which produces a plasma discharge resulting in current flow. It is normal for an arc to occur when an electrical circuit is switched. As a consequence, switch gear is designed to contain and quench an arc. However, arcs can also occur in abnormal, circumstances, triggered by a variety of factors such as a breakdown of insulation, conductive items accidentally being placed across live busbar or even animals straying across live conductors. Unfortunately, such occurrences can be quite destructive.

In this issue of TNL, we explore the reasons why arcs occur, and more importantly, identify how we can mitigate the risk of arc creation and possible damage to supply systems.

PLEASE CIRCULATE TO:

nhp.com.au
nhp-nz.com

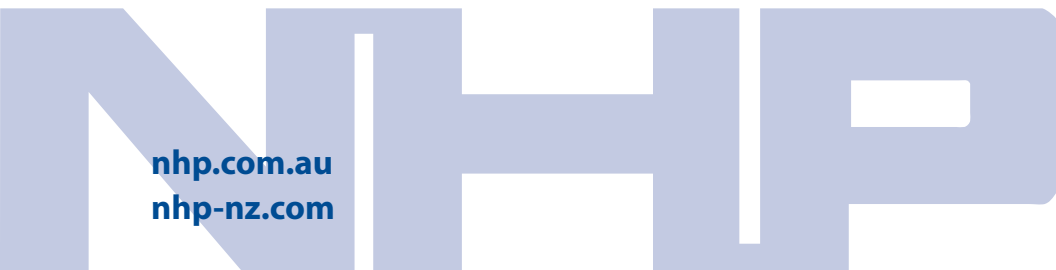

An electrical arc is one of the more spectacular phenomena within the world of electricity. Like a bolt of lightning, an arc is both a wondrous and beautiful form in nature, yet extremely powerful and potentially very destructive. Technically, an arc is defined as a luminous discharge of electricity across an insulating medium, usually accompanied by the partial vaporisation of electrodes. Yet arcs are very common, and usually result from any form of electrical switching. The key is to understand how to control and extinguish the “predictable” arcs that are inherent in the normal operation of switchgear, as well as to identify and suppress the unwanted arcs that can accidentally occur within electrical installations.

WHAT IS AN ARC FAULT?

In simple terms, an arc fault occurs when an electrical current flows across an air gap between two conductive surfaces. Some of the most common causes of an arc fault include:

- Loose or corroded connections exposing live conductors
- Damaged, frayed or pinched wires
- Poorly terminated or loose electrical connections
- Damaged plug in appliance cords and equipment
- Mechanical damage to conductors caused by wayward drill bits, nails or screws driven into live cables or bus bars
- Back hoes/earth moving equipment cutting through mains
- Rodents, reptiles or insects entering live switchboards
- Ionized gases released from switchgear clearing short circuits
- Accidental contact between live conductors and test probes or other tools

When an arc is initiated, the live conductors are in close enough proximity to create sparking. The arc itself is caused by uncontrolled conduction of electrical current from phase to phase, or from phase to earth/neutral, and this ionises the surrounding air. When conductive metal is vaporized, a pressure wave develops. A phase to phase, or phase to earth/neutral arc fault can escalate into a three phase arc within a millisecond. The heat energy and intense light produced at this stage is known as the arc flash.

Short circuits and arc faults are extremely dangerous and potentially fatal. The product of arc fault current and voltage generates a massive release of energy that manifests itself in heat and light. The arc temperature can reach four times that of the surface of the sun, causing third degree burns and possible blindness to anyone

in close proximity to the arc flash, and potentially igniting other flammable substances. These high temperatures vaporize conductors instantaneously. Copper vapour expands to 67,000 times the volume of solid copper. This pressure wave can often blow open panels and doors with explosive force, releasing the gases into the atmosphere and potentially exposing the remaining live conductors. These gases help sustain the arc and the duration of the arc is primarily determined by the time it takes for over current protective devices to open the circuit. The arc can actually extinguish itself in some instances. However, when a protective device identifies the arc as a “normal” load it will not clear the fault. When this occurs, the arc becomes “unlimited” and can continue to vapourise metal and copper until it literally burns holes in metal panels and propagates fire throughout a facility. Metal is blasted and splattered from the fault location. The shock wave is strong enough to damage anything or anyone within the immediate vicinity.



AN ARC FAULT IS A VERY DESTRUCTIVE FORCE

METHODS OF PREVENTING DAMAGE CAUSED BY ARC FAULTS

Now that we can appreciate the potential damage that can be caused by arcs, how do we prevent the arc from occurring? In low voltage installations, most arc damage occurs at the switchboard due to the presence of exposed copper conductors. There is a hierarchy of techniques designed to limit the effect of an arcing fault within a switchboard design:

1. ACTIVE arc fault suppression: achieved by using the appropriate settings on protective devices, OR by using optically triggered arc detect technology

2. PASSIVE arc prevention: achieved by insulating bus bars or by applying appropriate forms of separation in accordance with AS/NZS3439.1:2002

3. CONTAINMENT: constructing an enclosure that can sustain extreme mechanical force and can safely vent the arc away from the “personnel” zone

To understand the various techniques that can be applied to achieve the desired results, it is relevant to refer to AS/NZS3000:2007 and AS/NZS3439.1:2002.

AS/NZS3000:2007 Clause 2.5.5 identifies a number of methods of reducing the risk of arc initiation or reducing the potential damage caused by an arc for boards where the nominal current exceeds 800 A.

Method 1: Apply forms of separation

AS/NZS3000:2007 Clause 2.5.5.2 nominates the Forms of separation that apply to reduce the initiation of an arc within a switchboard.

These Forms are defined by AS/NZS3439.1, as per the extract below, and a minimum of IP2X (touch proof) is required internally. These two requirements limit the possibility that an arc can be initiated but must not be misconstrued as “arc fault containment”. Ultimately, if each bus bar phase is individually insulated then it is almost impossible to initiate a phase to phase or phase to earth arc.


AS/NZS3000 lists the acceptable forms of separation as follows:

- Form 3b, 3bi, 3bh, 3bih
- Form 4a, 4ah, 4aih, 4b, 4bi, 4bh, 4bih


Noting that the (i) determines that the insulation can be used to provide separation, and the (h) allows the housing of the protective switchgear to be used to provide separation. The difference between Form 3 and Form 4 is illustrated in the extract from AS/NZS3439, below.

Form 3

- Separation of busbars from the functional units
- +
- Separation of functional units from one another
- +
- Separation of terminals from functional units

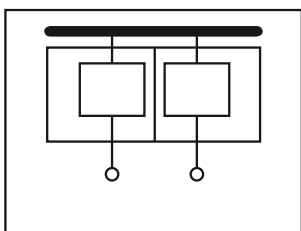


Form 3a:
Terminals not separated from busbars

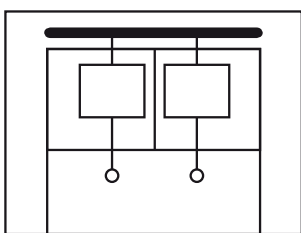


Form 3b:
Terminals separated from busbars

Form 4

- Separation of busbars from the functional units and terminals
- +
- Separation of functional units from one another
- +
- Separation of terminals associated with functional unit from those of another function



Form 4a:
Terminals in same compartment as associated functional unit



Form 4b:
Terminals not in same compartment as associated functional unit

IEC 1123/99

At the highest level, Form 3 and Form 4 separation helps to prevent arc initiation. Note that arcs tend to travel away from the line or supply side, and can “jump” to other conductors if ionized gases are present. Furthermore, Form 4a and Form 4b are specifically designed to allow safe access to a termination zone for maintenance purposes, without interrupting other circuits or risking electric shock.

Method 2: Arc fault containment

It must be noted that the form of separation (as described) cannot guarantee the integrity of the assembly in the event of an arcing fault. Annex ZC and ZD in AS/NZS3439.1:2002 details the additional measures that enhance the switchboard's ability to protect against the effects of internal arcing faults. Annex ZC focuses on arc prevention techniques, and Annex ZD specifies the testing process and criteria.

Extract from AS/NZS3439.1:2002, Annex ZC, clearly states:

"Specific objectives cover one or more of the following:


- (a) To provide means to reduce the probability of the initiation of an internal arcing fault.
- (b) To protect personnel from injury in the event of a fault under the normal operating conditions of the ASSEMBLY.
- (c) To limit as far as possible the extent of damage to equipment in the event of a fault."

Annex ZC is quite specific in its description of methods of limiting the ability of an arc to initiate, and thereafter limiting the damage caused by an arc if it does occur. It nominates

a combination of any one or more of the following solutions:

- 1. The use of insulation on all live conductors
- 2. Arranging functional units with venting to promote rapid extinction of an arc
- 3. Setting protective devices to interrupt the arc before it can cause damage
- 4. Using arc detection technology to interrupt the supply
- 5. Using earth fault detection to interrupt supply

How the switchboard ultimately achieves its aim is captured during the arc fault test as defined in Annex ZD. This is predetermined by the switchboard manufacturer in consultation with the testing authority. The arc fault test is quite specific in its requirement to limit the possibility of personnel injury. A curtain of gauze is placed in front of the switchboard on test. To pass the test, the gauze must not be ignited by an arc and the switchboard must maintain its designed IP rating. No other fittings or fixtures are allowed to be dislodged during the test. Standard load side arc fault tests are specified within the standard. However, it is also possible to construct special tests in consultation with the testing authority, such as line side or unlimited arc fault tests.

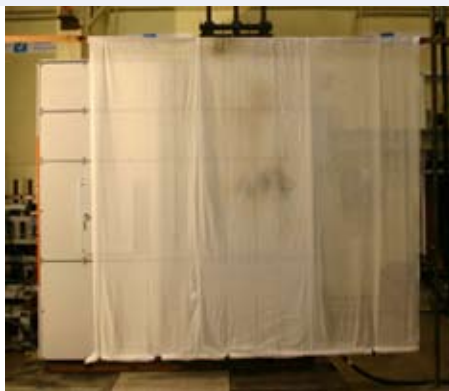

THE ARC FAULT TEST IS QUITE SPECIFIC IN ITS REQUIREMENT TO LIMIT THE POSSIBILITY OF PERSONNEL INJURY. A CURTAIN OF GAUZE IS PLACED IN FRONT OF THE SWITCHBOARD ON TEST.

Once the design is established, the test authority needs to initiate the arc within the switchboard. This is an art form in itself. Multiple strands of common fuse wire are fitted across the bus bar within the enclosure, usually at the point closest to the line side within the nominated chamber. This is illustrated in the images below. In some instances, it is possible for the arc to become unstable when the supply current is applied, and it can self extinguish before the arc fault test can take effect. . If this occurs, then the test must be repeated. It is a significant investment to build and test boards for arc faults as defined in AS/NZS3439.



ARC INITIATING FUSE WIRE WRAPPED AROUND BUSBAR CONNECTION PIECE



ARC INITIATING FUSE WIRE ON ACB MAIN TERMINALS

Method 3: Protective device settings

AS/NZS3000:2007 clause 2.5.5.3 defines the formula for calculating the trip curve settings for breakers to clear an arc fault when it occurs. This formula is based on the premise that an arc fault is approximately a third of the value of the prospective fault level at the point of initiation. The formula itself has its origins from one of the supply authorities, and has been used for this purpose for a number of years. To minimise the damage that an arc can cause to a switchboard, the main circuit breaker trip curve must be set to clear a calculated arc fault within a specific time frame.

The formula as follows: (Extract from AS/NZS3000:2007, Clause 2.5.5.3)

$$\text{Clearing time, } t = \frac{K(e) \times I(r)}{I(f)^{1.5}}$$

Where:

- t** = maximum clearing time in seconds
- k(e)** = 250 constant
- I(r)** = current rating of the switchboard
- I(f)** = 30% of the prospective fault current

Example:

- Typical 1200 A installation, fed by a supply Authority 1200 A fuse.
- NHP Terasaki XS1250SE MCCB is used as the main incomer
- The known fault level at a switchboard is 20.7 kA

Firstly, we need to calculate the clearing time:

$$t = \frac{250 \times 1200}{(0.3 \times 20\text{kA})^{1.5}} \qquad t = \frac{300,000}{(6\text{kA})^{1.5}}$$


t = 0.645 sec

Therefore, the XS1250SE must be set to clear a fault of 6 kA within 0.645 seconds

Using NHP's TemCurve 6 package, we can overlay the supply fuse with the XS1250 MCCB as illustrated right:

In this example, the XS1250 SE discriminates with the supply fuse (as is demanded by Clause 2.5.7 Reliability of Supply) and will interrupt the arc fault in accordance with the minimum time defined by the formula in Clause 2.5.5.3. However, it must be noted that the time current curve can occasionally make it more difficult to discriminate with downstream devices.

If this calculation method is applied to switchboards that are subject to higher fault levels, further considerations apply. The board must be designed to withstand the larger forces that will apply when exposed to a short circuit fault for the extended period of time as nominated by the calculation.

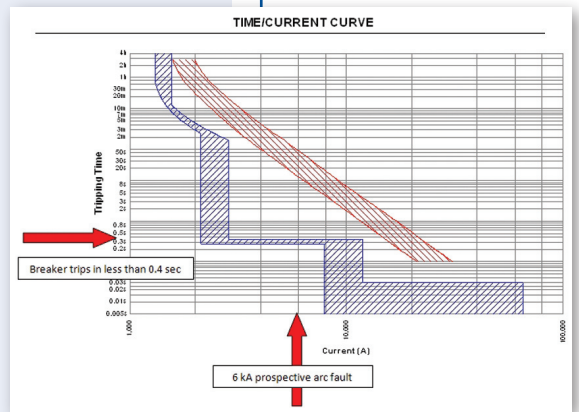

Method 4: Arc detect solutions

Another active form of arc fault suppression is to use optical sensors to identify the arc and trip the supply breaker. Typically, the Arc Detect sensors are fitted in close proximity to the bus bar within the switchboard, and can identify an arc as it develops. The Arc Detect relay can operate within 3-4 milliseconds to open the supply breaker via a shunt trip or under voltage trip. The total opening time is dependent on the time taken to then mechanically open the breaker. Air circuit breakers can take up to 40 ms to open in this manner. It is imperative that an arc is cleared as quickly as possible to limit the damage to the switch board and surrounding environment. Ironically, low arc fault levels as per the example above, can take longer to clear by the protective device. Even a 6 kA arc fault can cause substantial damage if allowed to propagate for 645 milliseconds as per the above example.



ARC DETECT RELAY



ARC DETECT SENSOR

Conclusion:

An arc fault is one of the most destructive electrical faults that we can encounter in a switchboard assembly. AS/NZS3439 and AS/NZS3000 proactively attempt to address this situation and offer alternative solutions to help manage this circumstance. Arcs can be quite unpredictable, so it is imperative that we understand the implications of an arc fault on our installations and select the appropriate method to prevent or extinguish the arc to limit damage to facilities and to limit the possibility of injuring personnel.

If you would like previous copies of Technical News, please complete the following form and **fax to NHP on (03) 9429 1075** to the attention of the **Marketing Department**.

Name: Title: Company:

Please post to: address

Telephone: () Fax: ()

Please email to:

Other issues currently available.

Please tick those you would like to receive.

- | | | |
|---|---|--|
| <ul style="list-style-type: none"> <input type="checkbox"/> 1. First edition (Latched and delayed contactors) <input type="checkbox"/> 2. Non-standard contactor applications (Parallel and series connections of contacts varying frequencies) <input type="checkbox"/> 3. Contactor failure (Reasons for the failure) <input type="checkbox"/> 4. Soft start for generator loads (Advantages of electronic soft starters) <input type="checkbox"/> 5. Set the protection (MCCB breakers and application) <input type="checkbox"/> 6. Contactor operating speed (Difference between AC and DC systems) <input type="checkbox"/> 7. Quick guide to fault levels (Calculating the approximate fault levels) <input type="checkbox"/> 8. IP ratings what do they mean? (IP Ratings, use and meaning) <input type="checkbox"/> 9. Utilisation categories (Electrical life of switches) <input type="checkbox"/> 10. AC variable frequency drives and breaking (Regenerative energy) <input type="checkbox"/> 11. Don't forget the motor protection (Motor protection devices and application) <input type="checkbox"/> 12. Electrical life of contactors (How and why contactors are tested) <input type="checkbox"/> 13. Liquid resistance starter developments (For large slipping motors) <input type="checkbox"/> 14. Taking the 'hiss' out of DC switching (DC switching principles) <input type="checkbox"/> 15. Start in the correct gear (Application of different motor starters) <input type="checkbox"/> 16. Application guide to lamp selection (Industrial pushbutton controls) | <ul style="list-style-type: none"> <input type="checkbox"/> 17. Electrical surges can be expensive (Electrical surges) <input type="checkbox"/> 18. Putting the PLC in control (advantages of the PLC) <input type="checkbox"/> 19. The thinking contactor (The development of the contactor) <input type="checkbox"/> 20. Some don't like it hot (Temperature rise in electrical switchgear) <input type="checkbox"/> 21. Pollution of the airwaves (Unwanted signals and their effects on motor protection devices) <input type="checkbox"/> 22. What's different about safety? (Safety devices and their application) <input type="checkbox"/> 23. Talk about torque (Motors and torque) <input type="checkbox"/> 24. Power factor what is it? (Power factor and correction equipment) <input type="checkbox"/> 25. Terminations, good or bad? (Terminals) <input type="checkbox"/> 26. RCDs are saving lives (Earth leakage protection; RCDs) <input type="checkbox"/> 27. The quality switchboard (Switchgear and protection devices for Switchboards) <input type="checkbox"/> 28. How does electrical equipment rate (Understanding ratings of electrical equipment) <input type="checkbox"/> 29. EMC - what's all the noise about (Understanding EMC) <input type="checkbox"/> 30. Controlling high short circuit currents with current limiting circuit breakers (Short circuit co-ordination KT 7) <input type="checkbox"/> 31. Another step in electrical safety (Changes to electrical safety) <input type="checkbox"/> 32. Keep your cables cool (New requirements on cable protection) <input type="checkbox"/> 33. A leak to earth can be electric (RCDs) | <ul style="list-style-type: none"> <input type="checkbox"/> 34. Keep Cool (Derating) <input type="checkbox"/> 35. Improving star-delta protection (Overload and short circuit protection) <input type="checkbox"/> 36. Does your CT measure up? (Selecting the correct current transformer) <input type="checkbox"/> 37. Is your copper flexible? (Flexible busbars) <input type="checkbox"/> 38. Where did the 10 volts go? (World uniform voltages) <input type="checkbox"/> 39. Motor protection and wiring rules (overload protection) <input type="checkbox"/> 40. Confused about which RCD you should be choosing? <input type="checkbox"/> 41. Circuit breakers working together <input type="checkbox"/> 42. Keeping in contact <input type="checkbox"/> 43. Is your switchboard in good form? <input type="checkbox"/> 44. Automation in a technological world <input type="checkbox"/> 45. Thermal simulation of switchgear <input type="checkbox"/> 46. Cable Considerations <input type="checkbox"/> 47. Output chokes for use with variable speed drives <input type="checkbox"/> 48. VSD Installation Techniques <input type="checkbox"/> 49. The modern Scada System <input type="checkbox"/> 50. 50th Edition Special <input type="checkbox"/> 51. Electrical design considerations for commercial buildings <input type="checkbox"/> 52. Terminal temperatures - how hot are they? <input type="checkbox"/> 53. Causes of premature failure <input type="checkbox"/> 54. Control voltages for contactors <input type="checkbox"/> 55. Will it turn you off? (Electrical switchgear welding) |
|---|---|--|

TNL is available as a download from NHP's Online Resource Centre (ORC), visit nhp-online.com.au The ORC provides members with up-to-the-minute technical information and powerful product tools, all at the click of a mouse button. Register for membership today!

Editorial content: Please address all enquiries to: The Editor - 'NHP Technical News' PO Box 199, Richmond, Victoria, 3121.



NHP Electrical Engineering Products Pty Ltd

A.B.N. 84 004 304 812

TNL 56 05/09 © Copyright NHP 2009



AUSTRALIA
nhp.com.au

VIC
MELBOURNE
+61 3 9429 2999
LAVERTON
+61 3 9368 2901
ALBURY/WODONGA
+61 2 6049 0600
DANDENONG
+61 3 8773 6400
TAS
HOBART
+61 3 6228 9575

NSW
SYDNEY
+61 2 9748 3444
NEWCASTLE
+61 2 4960 2220
CAMPBELLTOWN
+61 2 4620 4311
ACT
CANBERRA
+61 2 6280 9888

QLD
BRISBANE
+61 7 3909 4999
TOWNSVILLE
+61 7 4779 0700
ROCKHAMPTON
+61 7 4927 2277
TOOWOOMBA
+61 7 4634 4799
CAIRNS
+61 7 4035 6888

WA
PERTH
+61 8 9277 1777
NT
DARWIN
+61 8 8947 2666
SA
ADELAIDE
+61 8 8297 9055

NEW ZEALAND
nhp-nz.com

AUCKLAND
+64 9 276 1967
CHRISTCHURCH
+64 3 377 4407